

GENERAL NOTES

All dimensions shall remain the same as shown on contract plans, except dimensions (A) and (B) which are to be revised as shown to provide additional clearance. Additional concrete needed to revise dimension (A) and (B) =

needed to revise amension (A) and (B) = 0.0165 cu. yds./ft. of parapet.
Place aluminum sheet in curb portion at and near piers. Full thickness saw cut at all joint locations in lieu of cork joint filler.


1'-0"

#3 (E) BAR

"2" \$\phi\$ GFRP rebar lapped with #4 ex(E) bars (at saw cut locations) #3 (E) bar at 11" cts. #4 (E) bar-

<u>SECTION</u>

(Showing reinforcement clearances for slip forming and additional reinforcement bars)

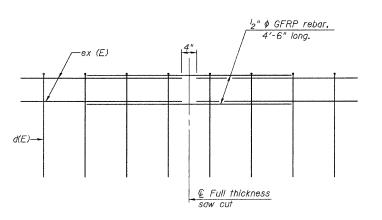

GFRP REBAR STIFFENING DETAIL

(Place as shown in parapet section at each parapet joint location.)

CONCRETE PARAPET SLIPFORMING OPTION

1'-2" 11½" (A)

sheet

... End of deck per plans

> Const. joint (mandatory)

Plan dimension + 1½" (B)

<u>SECTION</u> (Showing dimensions)

 $\frac{3_4}{}$ \triangle Drip notch full length

Face of parapet (as per superstructure details)

2'-10" (+0,-12")

(± ½")